
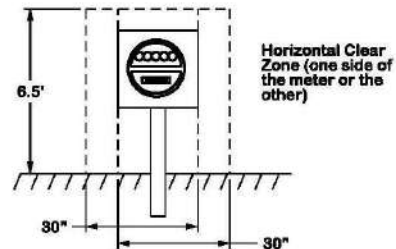
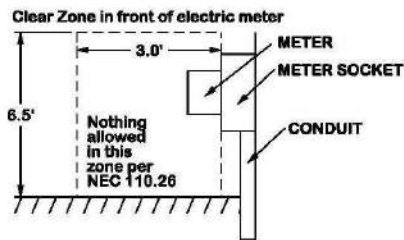
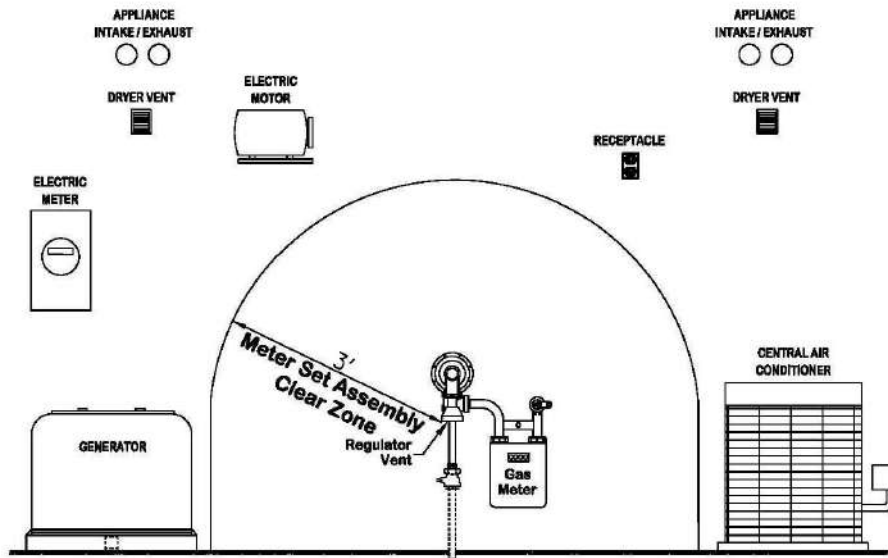


**Section 4 – Gas Metering**

**4-1 Clearance to Gas Meters ..... 2**

### 4-1 Clearance to Gas Meters

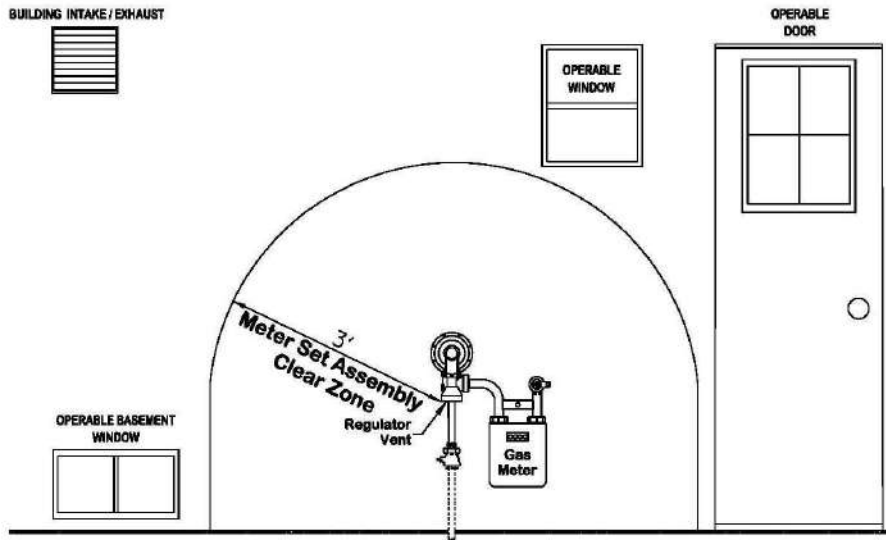

Notes:

1. Exhaust vents which may leak water, condensate, grease, oil, or other substances are not allowed above gas meters or other gas controls.
2. Avoid short overhangs which could cause ice problems in winter.
3. The National Electric Code 110.26 requires 3'-0" in front of electrical equipment including the electric meter socket. This clearance zone applies from the ground up to 6.5 feet.
4. The 3-foot radius clearance applies to clearances between the electric meter and the vents on LP regulators.