



Upper Peninsula Power Company

## GENERATOR INTERCONNECTION APPLICATION

### Category 3 (Combined Application)

**For All Projects with Aggregate Generator Output of More Than 150 kW but Less Than or Equal to 550 kW**

Also Serves as Application for Customer Owned Distributed Generation  
(Category 3 Only Available to Methane Digester Projects)

ELECTRIC UTILITY CONTACT INFORMATION		FOR OFFICE USE ONLY	
Upper Peninsula Power Company ATTN: Account Manager 500 N Washington Street Ishpeming, MI 49849 (906) 449-2013 customergeneration@uppc.com		Application Number	
		Date and Time Application Received	
<b>CUSTOMER / ACCOUNT INFORMATION</b> Electric Utility Customer Information (As shown on utility bill)			
Customer Name (Last, First, Middle)		Customer Mailing Address	
Customer Phone Number		Customer E-mail Address (Optional)	
Electric Service Account #		Electric Service Meter Number	
<b>Are you applying for the Distributed Generation Program?</b> <input type="checkbox"/> Yes <input type="checkbox"/> No		<b>Are you interested in selling Renewable Energy Credits (REC's)?</b> <input type="checkbox"/> Yes <input type="checkbox"/> No	
<b>Do you have an Alternative Electric Supplier?</b> <input type="checkbox"/> Yes <input type="checkbox"/> No If Yes, Name _____			
<b>Notes:</b> Enter name ONLY if your energy is supplied by a 3 <sup>rd</sup> party, not the utility. You must apply to both the Distribution Utility and your Alternate Energy Provider (if applicable) for Customer Owned Distributed Generation.			
<b>GENERATION SYSTEM SITE INFORMATION</b>			
Physical Site Service Address (If Not Billing Address)			
Annual Site Requirements Without Generation in kWh kWh/year	Peak Annual Site Demand in kW (only for customers billed on Demand Rates) kW	Attached Site Plan Page # _____	
Attached Electrical One-Line Drawing Page # _____  (Per MPSC Order in Case No. U-15787 – The One-Line Drawing must be signed and sealed by a licensed professional engineer, licensed in the State of Michigan or by an electrical contractor licensed by the State of Michigan with the electrical contractor's license number noted on the diagram.) <ul style="list-style-type: none"> <li>• See Page 5 for sample Site Plan</li> <li>• See Page 6 for sample of Inverter Generator Electrical One-Line Drawing</li> <li>• See Page 7 for sample of Synchronous Generator Electrical One-Line Drawing</li> <li>• See Page 8 for sample of Induction Generator Electrical One-Line Drawing</li> </ul>			
<b>GENERATION SYSTEM MANUFACTURER INFORMATION</b>			
System Type (Solar, Wind, Biomass Methane Digester, etc)		Generator Type (Inverter, Induction, Synchronous)	
Generator Nameplate Rating kW		Expected Annual Output in Kilowatt Hours kWh/year	
A.C. Operating Voltage		Wiring Configuration (Single Phase, Three Phase)	
Certified Test Record No. (Testing to Standard UL1741 scope 1.1a)			


INVERTER GENERATOR - BASED SYSTEMS		
Manufacturer	Model (Name/Number)	Inverter Power Rating (kW) kW
SYNCHRONOUS AND INDUCTION GENERATOR - BASED SYSTEMS (Must complete either Page 3 or Page 4 and attach Electrical One-Line Drawing)		
<p>The following information on these system components shall appear on the Electrical One-Line Drawing:</p> <ul style="list-style-type: none"> <li>Breakers – Rating, location and normal operating status (open or closed)</li> <li>Buses – Operating voltage</li> <li>Capacitors – Size of bank in Kvar</li> <li>Circuit Switchers – Rating, location and normal operating status (open or closed)</li> <li>Current Transformers – Overall ratio, connected ratio</li> <li>Fuses – Normal operating status, rating (Amps), type</li> <li>Generators – Capacity rating (kVA), location, type, method of grounding</li> <li>Grounding Resistors – Size (ohms), current (Amps)</li> <li>Isolating Transformers – Capacity rating (kVA), location, impedance, voltage ratings, primary and secondary connections and method of grounding</li> <li>Potential Transformers – Ratio, connection</li> <li>Reactors – Ohms/phase</li> <li>Relays – Types, quantity, IEEE device number, operator lines indicating the device initiated by the relays</li> <li>Switches – Location and normal operating status (open or closed), type, rating</li> <li>Tagging Point – Location, identification</li> </ul>		
Manufacturer	Model Name	Model Number
INSTALLATION INFORMATION Project Single Point of Contact: (Electric Utility Customer, Developer or Other)		
Name	Company (If Applicable)	Phone Number
E-Mail Address		Requested in Service Date
Licensed Contractor(Name of Firm or Self)		
Contractor's Name (Last, First, MI)	Contractor's Phone #	Contractor's E-mail
CUSTOMER AND PROJECT DEVELOPER/CONTRACTOR SIGNATURES AND FEES		
<div style="display: flex; justify-content: space-between;"> <div> <input type="checkbox"/> <b>Attached \$150 Interconnection Application Fee</b>    OR         </div> <div> <input type="checkbox"/> <b>Attached \$125 combined Interconnection and Customer Owned Distributed Generation Application Fee COMBINED</b> (Includes \$75 Interconnection Application fee along with \$50 Application Fee for Customer Owned Distributed Generation)         </div> </div> <div style="margin-top: 10px;"> <input type="checkbox"/> Check # _____      <input type="checkbox"/> Money Order # _____         </div> <p><b><i>Sign and Return Completed Application with Application Fee to Electric Utility Contact (at top of page 1).</i></b></p> <p><b>To the best of my knowledge, all the information provided in this application form is complete and correct.</b></p> <div style="display: flex; justify-content: space-between; margin-top: 20px;"> <div>Customer Signature: _____</div> <div>Date _____</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 20px;"> <div>Project Developer/Contractor Signature (if applicable): _____</div> <div>Date _____</div> </div> <p><small>Note: Refer to the applicable "Michigan Electric Utility Generator Interconnection Requirements" for a detailed explanation of the Interconnection Process, Fees, Timelines, and Technical Requirements.</small></p>		

SYNCHRONOUS GENERATORS	
GENERATOR INFORMATION	
Generator Nameplate Voltage	Generator Nameplate Watts or Volt-Amperes
Generator Nameplate Power Factor (pf)	RPM
TECHNICAL INFORMATION	
Minimum and Maximum Acceptable Terminal Voltage	Direct Axis Reactance (saturated)
Direct Axis Reactance (unsaturated)	Quadrature Axis Reactance (unsaturated)
Direct Axis Transient Reactance (saturated)	Direct Axis Transient Reactance (unsaturated)
Quadrature Axis Transient Reactance (unsaturated)	Direct Axis Sub-Transient Reactance (saturated)
Direct Axis Sub-Transient Reactance (unsaturated)	Leakage Reactance
Direct Axis Transient Open Circuit Time Constant	Quadrature Axis Transient Open Circuit Time Constant
Direct Axis Sub-Transient Open Circuit Time Constant	Quadrature Axis Sub-Transient Open Circuit Time Constant
Open Circuit Saturation Curve	
Reactive Capability Curve Showing Overexcited and Underexcited Limits (Reactive Information if Non-Synchronous)	
Excitation System Block Diagram with Values for Gains and Time Constants (Laplace Transforms)	
Short Circuit Current Contribution From Generator at the Point of Common Coupling	
Rotating Inertia of Overall Combination Generator, Prime Mover, Couplers and Gear Drives	
Station Power Load When Generator is Off-Line, Watts, pf	Station Power Load During Start-Up, Watts, pf
Station Power Load During Operation, Watts, pf	

INDUCTION GENERATORS	
GENERATOR INFORMATION	
Generator Nameplate Voltage	Generator Nameplate Watts or Volt-Amperes
Generator Nameplate Power Factor (pf)	RPM
TECHNICAL INFORMATION	
Synchronous Rotational Speed	Rotation Speed at Rated Power
Slip at Rated Power	Minimum and Maximum Acceptable Terminal Voltage
Motoring Power (kW)	Neutral Grounding Resistor (If Applicable)
I <sup>2</sup> 2t or K (Heating Time Constant)	Rotor Resistance
Stator Resistance	Stator Reactance
Rotor Reactance	Magnetizing Reactance
Short Circuit Reactance	Exciting Current
Temperature Rise	Frame Size
Design Letter	Reactive Power Required in Vars (No Load)
Reactive Power Required in Vars (Full Load)	
Short Circuit Current Contribution from Generator at the Point of Common Coupling	
Rotating Inertia, H in Per Unit on kVA Base, of Overall Combination Generator, Prime Mover, Couplers and Gear Drives	
Station Power Load When Generator is Off-Line, Watts, pf	Station Power Load During Start-Up, Watts, pf
Station Power Load During Operation, Watts, pf	

## SAMPLE SITE PLAN – PROVIDED FOR REFERENCE ONLY

SITE PLAN
Applicant
Address
City/Town
Signature

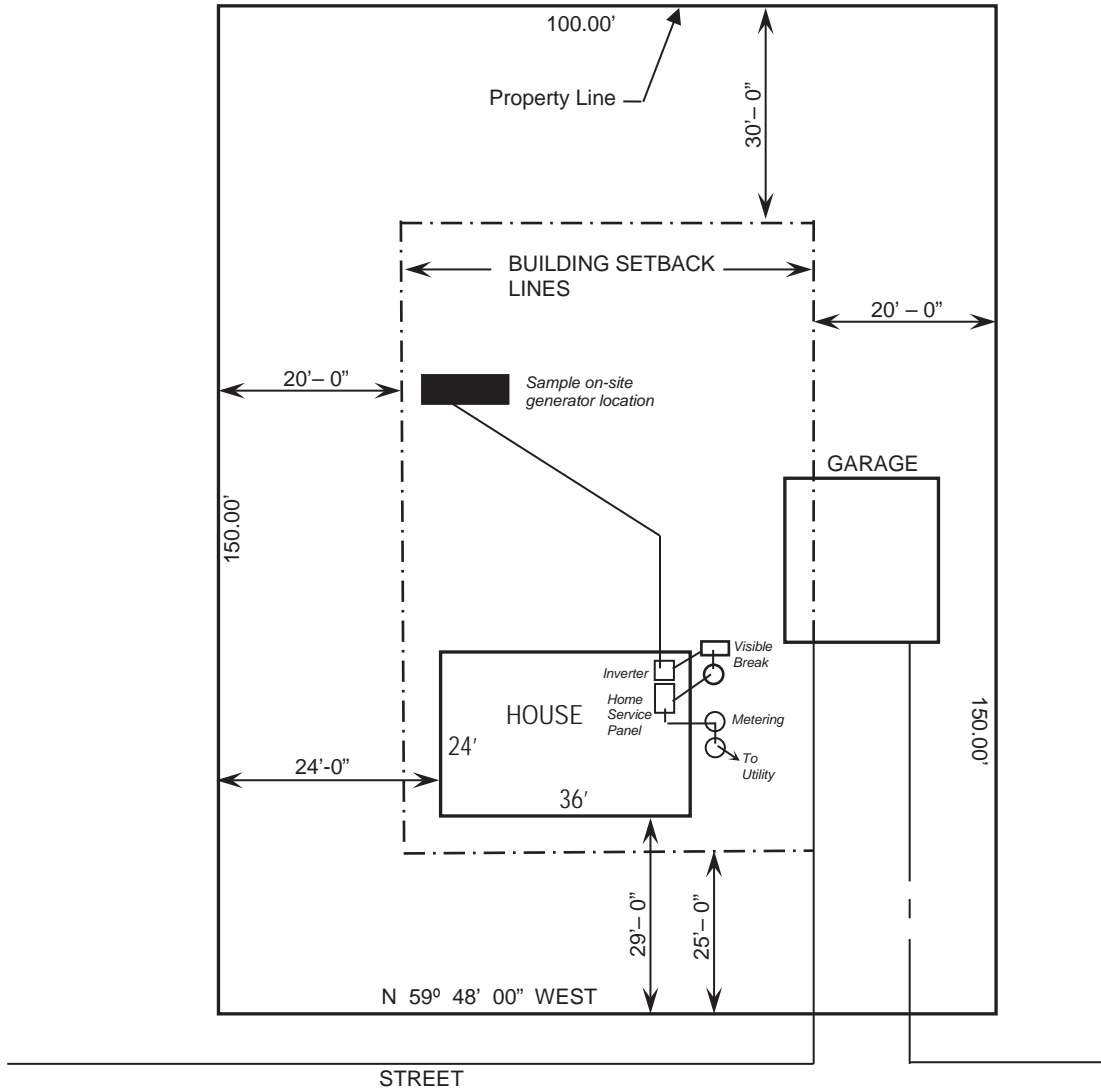

Weblink to State of Michigan / Plats:


[http://www.cis.state.mi.us/platmaps/sr\\_subs.asp](http://www.cis.state.mi.us/platmaps/sr_subs.asp)

*Legible hand drawn site plans are acceptable*

## SAMPLE ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY

### INVERTER GENERATOR UL 1741 SCOPE 1.1A COMPLIANT

ONE-LINE DRAWING
Licensed PE/Contractor
PE/Contractor License Number
PE/Contractor Address
PE/Contractor Signature

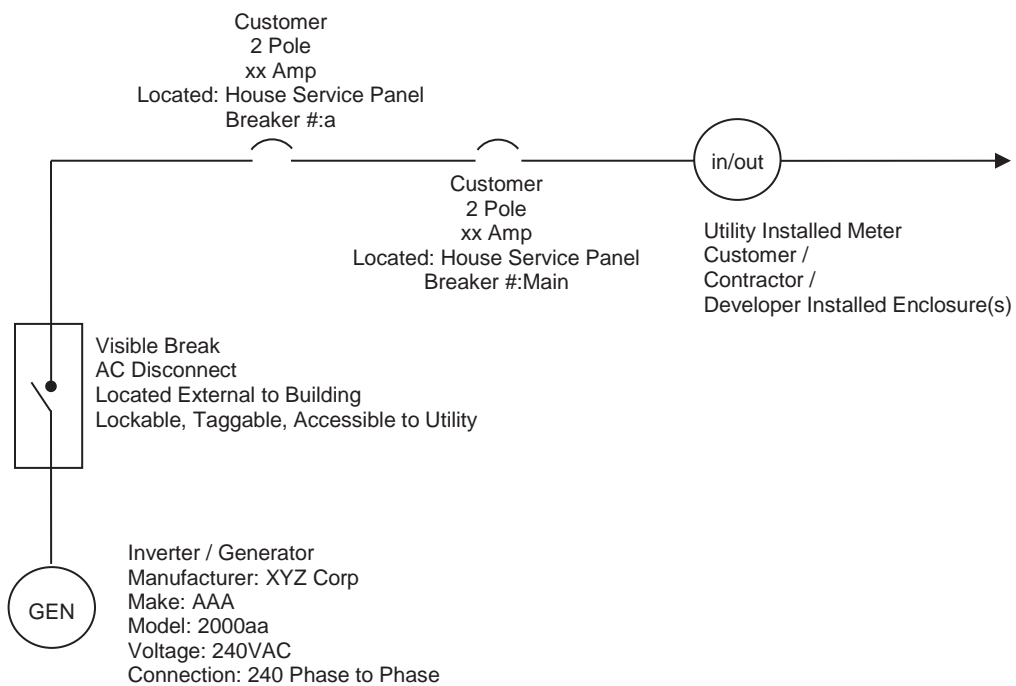


*Legible Hand Drawn One-Line is Acceptable*

# SAMPLE ELECTRICAL ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY

## TYPICAL ISOLATION AND FAULT PROTECTION FOR SYNCHRONOUS GENERATOR

ONE-LINE DRAWING	
Licensed PE/Contractor	PE/Contractor License Number
PE/Contractor Address	PE/Contractor Signature

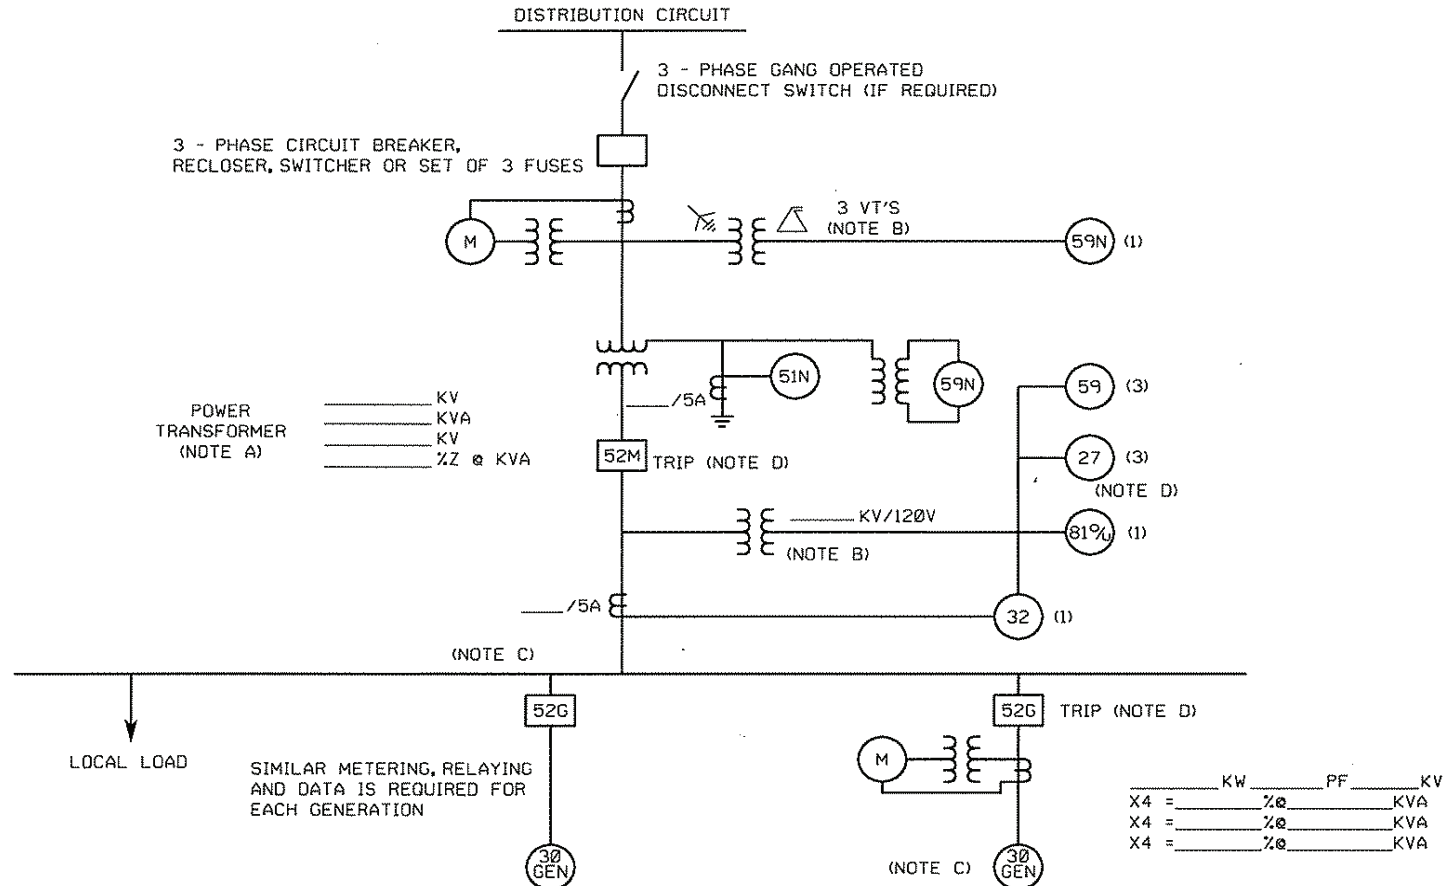

### LEGEND

- 27 Undervoltage
- 32 Reverse Power (Not Required for Flow-Back)
- 51N Neutral overcurrent (required for grounded secondary)
- 59 Overvoltage
- 59N Zero sequence overvoltage (assuming ungrounded secondary on power transformer)
- 81o/u Over/Underfrequency


### NOTES

- See technical requirements for permissible connection configurations and protection. Transformer connections proposed shall be shown on the one-line drawing by the Project Developer. Transformer connection and secondary grounding to be approved by Utility.
- Protection alternatives for the various acceptable transformer connections are shown. Only one protection alternative will ultimately be used, depending on the actual transformer winding connections. VT's for 59, 27, 81o/u and 32 are shown connected on the primary (Project side) of the power transformer, but may instead be connected on the secondary (Utility side). VT's are required on the secondary of the power transformer if a 59N is required for an ungrounded secondary connection. IEEE std 1547 requirements for voltage and frequency must be met at the PCC. IEEE Std. 1547 permits the VT's to be connected at the point of generator connection in certain cases.
- Main breaker protection, generator protection and synchronizing equipment are not shown.
- Trip of all 52G breakers or the 52M breaker is acceptable, depending upon whether the Project Developer wants to serve its own isolated load after loss of Utility service.

# SAMPLE ELECTRICAL ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY

## TYPICAL ISOLATION AND FAULT PROTECTION FOR INDUCTION GENERATOR

ONE-LINE DRAWING	
Licensed PE/Contractor	PE/Contractor License Number
PE/Contractor Address	PE/Contractor Signature

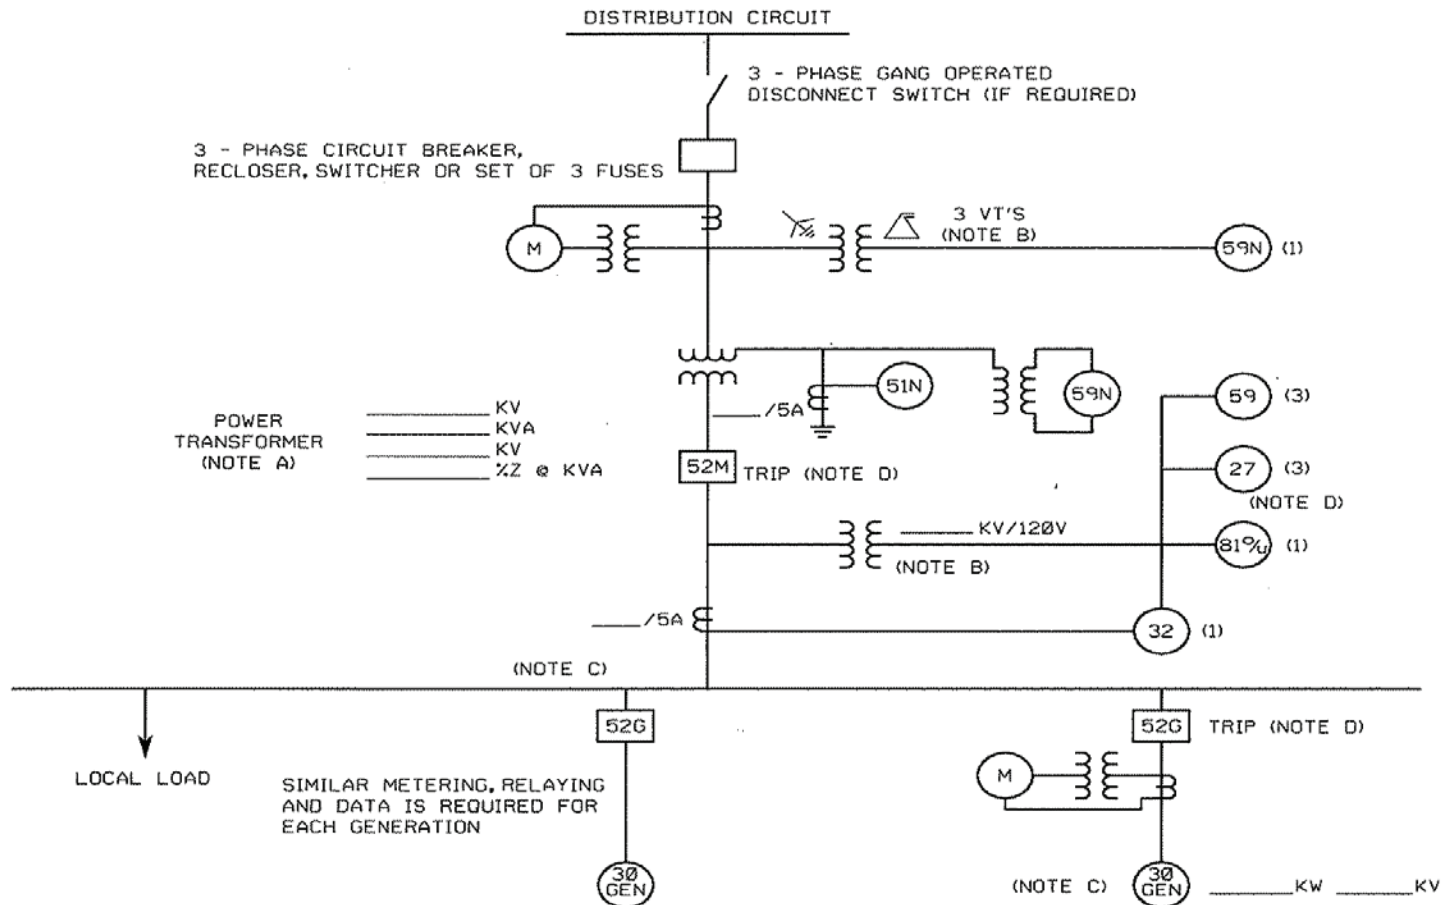

### LEGEND

- 27 Undervoltage
- 32 Reverse Power (Not Required for Flow-Back)
- 51N Neutral overcurrent (required for grounded secondary)
- 59 Overvoltage
- 59N Zero sequence overvoltage (assuming ungrounded secondary on power transformer)
- 81o/u Over/Underfrequency

### NOTES

- A) See technical requirements for permissible connection configurations and protection. Transformer connections proposed shall be shown on the one-line drawing by the Project Developer. Transformer connection and secondary grounding to be approved by Utility.
- B) Protection alternatives for the various acceptable transformer connections are shown. Only one protection alternative will ultimately be used, depending on the actual transformer winding connections. VT's for 59, 27, 81o/u and 32 are shown connected on the primary (Project side) of the power transformer, but may instead be connected on the secondary (Utility side). VT's are required on the secondary of the power transformer if a 59N is required for an ungrounded secondary connection. IEEE std 1547 requirements for voltage and frequency must be met at the PCC. IEEE Std. 1547 permits the VT's to be connected at the point of generator connection in certain cases.
- C) Main breaker protection, generator protection and synchronizing equipment are not shown.
- D) Trip of all 52G breakers or the 52M breaker is acceptable, depending upon whether the Project Developer wants to serve its own isolated load after loss of Utility service.