



Upper Peninsula Power Company

A Michigan Electric Utility

Generator Interconnection Requirements

Category 1

**Projects with
Aggregate Generator Output
20 kW or Less**

Introduction

Category 1 – 20kW or Less Generator Interconnection Requirements

This Generator Interconnection Procedure document outlines the process & requirements used to install or modify generation projects with aggregate generator output capacity ratings less than 20kW and designed to operate in parallel with the UPPCO electric system. Technical requirements (data, equipment, relaying, telemetry, metering) are defined according to type of generation, location of the interconnection, and mode of operation (Flow-back or Non-Flow-back). The process is designed to provide an expeditious interconnection to the UPPCO electric system that is both safe and reliable.

UPPCO complies with the Michigan Public Service Commission (MPSC) and files a net metering report annually. ¹The annual net metering report UPPCO submits complies with rules established for the interconnection of parallel generation to the UPPCO electric system in the MPSC Order in Case No. U-15787.

The term “Project” will be used throughout this document to refer to electric generating equipment and associated facilities that are not owned or operated by an electric utility. The term “Project Developer” means a person that owns, operates, or proposes to construct, own, or operate, a Project.

¹ The net metering program was discontinued and closed to new customers as of May 23, 2019, as a result of the Commission Order approving Case U – 20276. As required, UPPCO will continue to file the annual net metering report with the MPSC annually until grandfathered program participant commitments have been reached.

**Category 1
Generator Interconnection Requirements**

Table of Contents

INTERCONNECTION PROCESS 5

 CUSTOMER PROJECT PLANNING PHASE 5

 APPLICATION & QUEUE ASSIGNMENT 5

 APPLICATION REVIEW 5

 ENGINEERING REVIEW 6

 DISTRIBUTION STUDY 6

 CUSTOMER INSTALL & POA 6

 METER INSTALL, TESTING, & INSPECTION 7

 OPERATION IN PARALLEL 7

OPERATIONAL PROVISIONS 7

 DISCONNECTION 7

 MAINTENANCE AND TESTING 7

TECHNICAL REQUIREMENTS 8

MAJOR COMPONENT DESIGN REQUIREMENTS 8

 DATA 8

 ISOLATING TRANSFORMER(S) 9

 ISOLATION DEVICE 9

 INTERCONNECTION LINES 9

RELAYING DESIGN REQUIREMENTS 9

 MOMENTARY PARALLELING 10

 AUTOMATIC RECLOSING 10

 SINGLE-PHASE SECTIONALIZING 10

 SPECIFIC REQUIREMENTS BY GENERATOR TYPE 11

 Synchronous Projects 11

 Induction Project 11

 Inverter Projects 11

 Relay Setting Criteria 11

 MAINTENANCE AND TESTING 11

 INSTALLATION APPROVAL 12

MISCELLANEOUS OPERATIONAL REQUIREMENTS 12

 OPERATING IN PARALLEL 12

REACTIVE POWER CONTROL	13
SITE LIMITATIONS.....	14
REVENUE METERING REQUIREMENTS.....	14
NON-FLOW BACK PROJECTS.....	14
FLOW BACK PROJECTS.....	14
COMMUNICATION CIRCUITS.....	15
Appendix A	16
Interconnection Table – Applicant Costs	16
Combined Distributed Generation / Interconnection Table – Applicant Costs	16
Interconnection Timeline – Working Days.....	16
Appendix B	17
Procedure Definitions	17
Appendix C.....	20
Site Plan.....	20
Appendix D.....	21
Sample One-Line Diagram for Inverter Projects	21
Appendix E	22
The Following Sample One-Line Diagrams are Available upon Request:	22
1. Sample One-Line Diagram for Synchronous Projects	22
2. Sample One-Line Diagram for Induction Projects.....	22
3. Sample One-Line Diagram for Non-Flow Back Projects.....	22
4. Sample One-Line Diagram for Flow Back Projects	22

Generator Interconnection Procedures

Category 1 20kW or Less

INTERCONNECTION PROCESS

CUSTOMER PROJECT PLANNING PHASE

An applicant may contact UPPCO before or during the application process regarding the project. UPPCO can be reached by phone, e-mail, or by the external website to access information, forms, rates, and agreements. A utility will provide up to 2 hours of technical consultation at no additional cost to the applicant. Consultation may be limited to providing information concerning UPPCO's system operating characteristics and location of system components.

APPLICATION & QUEUE ASSIGNMENT

The Project Developer must first submit a combined Interconnection and Distributed Generation Application (*Combined Application*) to UPPCO. A separate application is required for each Project or Project site. The blank Interconnection Application can be found on [the Customer Generated Electricity page of UPPCO's website](#).

A complete submittal of required interconnection data and Interconnection filing fee per the table in Appendix B is \$125 for the Combined Application. UPPCO will verify receipt to the Project Developer within 10 business days of receipt of a Combined Application. If any portion of the Combined Application, data submittal (a site plan and the one-line diagrams), or filing fee is incomplete and/or missing, UPPCO will return the application, data, and filing fee to the Project developer with explanations. Project Developer will need to resubmit the application with all the missing items.

Once UPPCO has accepted the Combined Application, a queue number will be assigned to the Project. UPPCO will then advise the applicant that the application is complete and provide the customer with the queue assignment.

APPLICATION REVIEW

UPPCO shall review the Combined Application to determine if an engineering review is required. UPPCO will notify the Project Developer within 10 business days of receipt of complete application and if an engineering review is required. If an engineering review is required, UPPCO will apply for an MPSC waiver to complete an Engineering Review and notify the applicant of the waiver request. The applicant is exempt from the cost of the engineering review. Upon MPSC granting the waiver request UPPCO will proceed with an engineering review. The applicant shall provide any changes or updates to the application

before the engineering review begins. If an engineering review is not required or the MPSC denies the waiver request, the project will advance to the Meter install, Testing, & Inspection phase of the process. UPPCO may request additional data be submitted as necessary during the review phase to clarify the operation of the Project.

ENGINEERING REVIEW

Upon MPSC granting the waiver request, UPPCO shall study the project to determine the suitability of the interconnection equipment including safety and reliability complications arising from equipment saturation, multiple technologies, and proximity to synchronous motor loads. The electric utility shall provide in writing the results of the engineering study within the time indicated in the MPSC waiver request. If the engineering review indicates that a distribution study is necessary, the electric utility shall request an MPSC waiver to perform the distribution study. The customer is exempt from the cost of a distribution study except with respect to any distribution study costs that may be included in and applicable to the customer through the Company's general tariff rates for the relevant customer class. If an engineering review determines that a distribution study is not required, the project will advance to the *Meter install, Testing, & Inspection*.

DISTRIBUTION STUDY

Upon MPSC granting the waiver request, UPPCO shall study the project to determine if a distribution system upgrade is needed to accommodate the proposed project and determine the cost of an upgrade if required. The applicant is exempt from the cost of the study and upgrades if required, except with respect to any distribution study costs that may be included in and applicable to the customer through the Company's general tariff rates for the relevant customer class. The electric utility shall provide in writing the results of the distribution study including estimated completion timeframe for the upgrades, if required, to the applicant, within the timeframe allowed by the waiver request. If a distribution study determines that a distribution upgrades are not required, the project will advance to the *Meter install, Testing, & Inspection* phase of the process.

CUSTOMER INSTALL & POA

The applicant shall notify the electric utility when an installation and any required local code inspection and approval is complete. The Parallel Operating Agreement can be found from UPPCO's customer generation website. The Parallel Operating Agreement will cover matters customarily addressed in such agreements in accordance with Good Utility Practice, including, without limitation, construction of facilities, system operation, interconnection rate, defaults and remedies, and liability. The applicant shall complete, sign and return the POA (Parallel Operating Agreement) to UPPCO. Any delay in the applicant's execution of the Interconnection and Operating Agreement will not count toward the interconnection deadlines.

METER INSTALL, TESTING, & INSPECTION

Upon receipt of the local code inspection approval and executed POA, UPPCO will schedule the meter install, testing, and inspection. UPPCO shall have an opportunity to schedule a visit to witness and perform commissioning tests required by IEEE 1547.1 and inspect the project. UPPCO may provide a waiver of its right to visit the site to inspect the project and witness or perform the commissioning tests. UPPCO shall notify the applicant of its intent to visit the site, inspect the project, witness or perform the commissioning tests, or of its intent to waive inspection within 10 working days after notification that the installation and local code inspections have passed. Within 5 working days from receipt of the completed commissioning test report (if applicable), UPPCO will notify the applicant of its approval or disapproval of the interconnection. If UPPCO does not approve the interconnection, UPPCO shall notify the applicant of the necessary corrective actions required for approval. The applicant, after taking corrective action, may request UPPCO reconsider the interconnection request.

OPERATION IN PARALLEL

Upon UPPCO approval of the interconnection, UPPCO shall install required metering, provide to the applicant a written statement of final approval, and a fully executed POA authorizing parallel operation.

OPERATIONAL PROVISIONS

DISCONNECTION

UPPCO may refuse to connect or may disconnect a project from the distribution system if any of the following conditions apply:

- Lack of fully executed interconnection agreement (POA)
- Termination of interconnection by mutual agreement
- Noncompliance with technical or contractual requirements in the interconnection agreement after notice is provided to the applicant of the technical or contractual deficiency.
- Distribution system emergency
- Routine maintenance, repairs, and modifications, but only for a reasonable length of time necessary to perform the required work and upon reasonable notice.

MAINTENANCE AND TESTING

UPPCO reserves the right to test the relaying and control equipment that involves protection of UPPCO's electric system whenever UPPCO determines a reasonable need for such testing exists.

The applicant is solely responsible for conducting and documenting proper periodic maintenance on the generating equipment and its associated control, protective equipment, interrupting devices, and main Isolation Device, per manufacturer recommendations.

Routine and maintenance checks of the relaying and control equipment must be conducted in accordance with provided written test procedures which are required by IEEE Std. 1547, and test reports of such testing shall be maintained by the applicant and made available for UPPCO inspection upon request. [NOTE – IEEE 1547 requires that testing be conducted in accordance with written test procedures, and the nationally recognized testing laboratory providing certification will require that such test procedures be available before certification of the equipment.]

TECHNICAL REQUIREMENTS

The following discussion details the technical requirements for interconnection of Category 1 Projects 20 kW or less. For Projects within this capacity rating range, UPPCO has made a significant effort to simplify the technical requirements. This effort has resulted in adoption of IEEE Standard 1547, Standard for Interconnecting Distributed Resources with Electric Power Systems, being incorporated herein by reference. All protective functions are compliant with IEEE Standard 1547.

Certain requirements, as specified by this document, must be met to provide compatibility between the Project and UPPCO's electric system, and to assure that the safety and reliability of the electric system is not degraded by the interconnection. UPPCO reserves the right to evaluate and apply newly developed protection and/or operation schemes at its discretion. In addition, UPPCO reserves the right to evaluate Projects on an ongoing basis as system conditions change, such as circuit loading, additional generation placed online, etc.

Upgraded revenue metering may be required for the Project.

MAJOR COMPONENT DESIGN REQUIREMENTS

The data requested in Appendix E, F, or G for all major equipment and relaying proposed by the Project Developer, must be submitted as part of the initial application for review and approval by UPPCO. UPPCO may request additional data be submitted as necessary during the Distribution Study phase to clarify the operation of the Project.

Once installed, the interconnection equipment must be reviewed and approved by UPPCO prior to being connected to UPPCO's electric system and before Parallel Operation is allowed.

DATA

The data that UPPCO requires to evaluate the proposed interconnection is documented on a one-line diagram by generator type in Appendices E, F, or G.

A site plan, one-line diagrams, and interconnection protection system details of the Project are required as part of the application data. The generator manufacturer supplied data package should also be supplied.

ISOLATING TRANSFORMER(S)

If a Project Developer installs an isolating transformer, the transformer must comply with the current ANSI Standard C57.12.

The type of generation and electrical location of the interconnection will determine the isolating transformer connections. Allowable connections are detailed in the “Specific Requirements by Generator Type” section. Note: Some Utilities do not allow an isolation transformer to be connected to a grounded Utility system with an ungrounded secondary (Utility side) winding configuration, regardless of the Project type. Therefore, the Project Developer is encouraged to consult with UPPCO prior to submitting an application.

ISOLATION DEVICE

After review, this device may not be required by UPPCO. If required and/or installed, this device would be placed at the Point of Common Coupling (PCC). It can be a circuit breaker, circuit switcher, pole top switch, load-break disconnect, etc., depending on the electrical system configuration. The following are required of the isolation device:

- Must be approved for use on the UPPCO system.
- Must comply with current relevant ANSI and/or IEEE Standards.
- Must have load break capability, unless used in series with a three-phase interrupting device.
- Must be rated for the application.
- If used as part of a protective relaying scheme, it must have adequate interrupting capability. UPPCO will provide maximum short circuit currents and X/R ratios available at the PCC upon request.
- Must be operable and accessible by UPPCO at all times (24 hours a day, 7 days a week)

UPPCO will determine if the isolation device will be used as a protective tagging point. If the determination is so made, the device must have a visible open break, provisions for padlocking in the open position and it must be gang operated. If the device has automatic operation, the controls must be located remote from the device.

INTERCONNECTION LINES

Any new line construction to connect the Project to UPPCO’s electric system will be undertaken by UPPCO at UPPCO’s expense.

RELAYING DESIGN REQUIREMENTS

Regardless of the technology of the interconnection, for simplicity for all Projects in this capacity rating range, the interconnection relaying system must be certified by a nationally

recognized testing laboratory to meet IEEE Std. 1547. The data submitted for review must include information from the manufacturer indicating such certification, and the manufacturer must placard the equipment such that a field inspection can verify the certification. A copy of this standard may be obtained (for a fee) from the Institute of Electrical and Electronics Engineers (www.ieee.org).

If the protective system uses AC power as the control voltage, it must be designed to disconnect the generation from the UPPCO electric system if the AC control power is lost. Utility will work with Project Developer for system design for this requirement.

MOMENTARY PARALLELING

For situations where the Project will only be operated in parallel with UPPCO's electric system for a short duration (100 milliseconds or less), as in a make-before-break automatic transfer scheme, no additional relaying is required. Such momentary paralleling requires a modern integrated Automatic Transfer Switch (ATS) system, which is incapable of paralleling the Project with UPPCO's electric system. The ATS must be tested, verified, and documented by the Project Developer for proper operation at least every 2 years. UPPCO may be present during this testing.

AUTOMATIC RECLOSING

UPPCO employs automatic multiple-shot reclosing on most of UPPCO's circuit breakers and circuit reclosers to increase the reliability of service to its customers. Automatic single-phase overhead reclosers are regularly installed on distribution circuits to isolate faulted segments of these circuits.

The Project Developer is advised to consider the effects of Automatic Reclosing (both single phase and three phase) to assure that the Project's internal equipment will not be damaged. In addition to the risk of damage to the Project, an out-of-phase reclosing operation may also present a hazard to Utility equipment since this equipment may not be rated or built to withstand this type of reclosing. UPPCO will determine relaying and control equipment that needs to be installed to protect its own equipment from out-of-phase reclosing. Installation of this protection will be undertaken by UPPCO at UPPCO's expense. UPPCO shall not be liable to the customer with respect to damage(s) to the Project arising as a result of Automatic Reclosing.

SINGLE-PHASE SECTIONALIZING

UPPCO also installs single-phase fuses and/or reclosers on its distribution circuits to increase the reliability of service to its customers. Three-phase generator installations may require replacement of fuses and/or single-phase reclosers with three-phase circuit breakers or circuit reclosers at UPPCO's expense.

SPECIFIC REQUIREMENTS BY GENERATOR TYPE

Synchronous Projects

An isolation transformer may be required for three-phase Synchronous Generator Facilities. Except as noted below, the isolation transformer must be incapable of producing ground fault current to the UPPCO system; any connection except delta primary (Project side), grounded-wye secondary (Utility side) is acceptable. A grounded-wye - grounded-wye transformer connection is acceptable only if the Project's single line-to-ground fault current contribution is less than the Project's three-phase fault current contribution at the PCC. Protection must be provided for internal faults in the isolating transformer; fuses are acceptable.

For a sample One-Line Diagram of this type of facility, see Appendix F.

Induction Project

For three-phase installations, any isolation transformer connection is acceptable except grounded-wye (Utility side), delta (Project side). Protection must be provided for internal faults in the isolating transformer; fuses are acceptable. UPPCO does not require the Project Developer to provide any protection for Utility system ground faults.

For a sample One-Line Diagram of this type of facility, see Appendix G.

Inverter Projects

No isolation transformer is required between the generator and the secondary distribution connection. If an isolation transformer is used for three-phase installations, any isolation transformer connection is acceptable except grounded-wye (Utility side), delta (Project side). Protection must be provided for internal faults in the isolating transformer; fuses are acceptable. UPPCO does not require the Project Developer to provide any protection for Utility system ground faults.

For a sample One-Line Diagram of this type of facility, see Appendix E.

Relay Setting Criteria

The relay settings for Projects 20 kW or less must conform to the values specified in IEEE Std. 1547.

MAINTENANCE AND TESTING

UPPCO reserves the right to test the relaying and control equipment that involves protection of UPPCO's electric system whenever UPPCO determines a reasonable need for such testing exists.

The Project Developer is solely responsible for conducting and documenting proper periodic maintenance on the generating equipment and its associated control, protective equipment, interrupting devices, and main Isolation Device, per manufacturer recommendations.

Routine and maintenance checks of the relaying and control equipment must be conducted in accordance with provided written test procedures which are required by IEEE Std. 1547, and test reports of such testing shall be maintained by the Project Developer and made available for Utility inspection upon request. [NOTE – IEEE 1547 requires that testing be conducted in accordance with written test procedures, and the nationally recognized testing laboratory providing certification will require that such test procedures be available before certification of the equipment.]

INSTALLATION APPROVAL

The Project Developer must provide UPPCO with 5 business days advance written notice of when the Project will be ready for inspection, testing, and approval.

Prior to final approval for Parallel Operation, UPPCO reserves the right to inspect the Project and require action to assure conformance to the requirements stated herein.

MISCELLANEOUS OPERATIONAL REQUIREMENTS

Miscellaneous requirements include synchronizing equipment for Parallel Operation, reactive requirements, and system stability limitations.

OPERATING IN PARALLEL

The Project Developer will be solely responsible for the required synchronizing equipment and for properly synchronizing the Project with UPPCO's electric system.

Voltage fluctuation at the PCC during synchronization is limited per IEEE Std. 1547.

These requirements are directly concerned with the actual operation of the Project with UPPCO:

- The Project may not commence parallel operation until approval has been given by UPPCO. The completed installation is subject to inspection by UPPCO prior to approval. Preceding this inspection, all contractual agreements must be executed by the Project Developer.
- The Project must be designed to prevent the Project from energizing into a de-energized Utility line. The Project's circuit breaker or contactor must be blocked from closing in on a de-energized circuit.
- The Project shall discontinue parallel operation with a particular service and perform necessary switching when requested by UPPCO for any of the following reasons:
- When public safety is being jeopardized.
- During voltage or loading problems, system emergencies, or when abnormal sectionalizing or circuit configuration occurs on the UPPCO system.

- During scheduled shutdowns of Utility equipment that are necessary to facilitate maintenance or repairs. Such scheduled shutdowns shall be coordinated with the Project.
- In the event there is demonstrated electrical interference (i.e. Voltage Flicker, Harmonic Distortion, etc.) to UPPCO's customers, suspected to be caused by the Project, and such interference exceeds then current system standards, UPPCO reserves the right, at UPPCO's initial expense, to install special test equipment as may be required to perform a disturbance analysis and monitor the operation and control of the Project to evaluate the quality of power produced by the Project. In the event that no standards exist, then the applicable tariffs and rules governing electric service shall apply. If the Project is proven to be the source of the interference, and that interference exceeds UPPCO's standards or generally accepted industry standards, then it shall be the responsibility of the Project Developer to eliminate the interference problem and to reimburse UPPCO for the costs of the disturbance monitoring installation, removal, and analysis excluding the cost of the meters or other special test equipment.
- When either the Project or its associated synchronizing and protective equipment is demonstrated by UPPCO to be improperly maintained, so as to present a hazard to the UPPCO system or its customers.
- Whenever the Project is operating isolated with other Utility customers, for whatever reason.
- Whenever UPPCO notifies the Project Developer in writing of a claimed non-safety related violation of the Interconnection Agreement and the Project Developer fails to remedy the claimed violation within ten working days of notification, unless within that time either the Project Developer files a complaint with the MPSC seeking resolution of the dispute or the Project Developer and Utility agree in writing to a different procedure.

If the Project has shown an unsatisfactory response to requests to separate the generation from the UPPCO system, UPPCO reserves the right to disconnect the Project from parallel operation with the UPPCO electric system until all operational issues are satisfactorily resolved.

REACTIVE POWER CONTROL

Synchronous generators that will operate in the Flow-back Mode must be dynamically capable of providing 0.90 power factor lagging (delivering reactive power to UPPCO) and 0.95 power factor leading (absorbing reactive power from UPPCO) at the Point of Receipt. The Point of Receipt is the location where UPPCO accepts delivery of the output of the Project. The Point of Receipt can be the physical location of the billing meters or a location where the billing meters are not located, but adjusted for line and transformation losses.

Induction and Inverter- Projects that will operate in the Flow-back Mode must provide for their own reactive needs (steady state unity power factor at the Point of Receipt). To obtain unity power factor, the Induction or Inverter Project can:

1. Install a switchable Volt-Ampere reactive (VAR) supply source to maintain unity power factor at the Point of Receipt; or
2. Provide UPPCO with funds to install a VAR supply source equivalent to that required for the Project to attain unity power factor at the Point of Receipt at full output.

There are no interconnection reactive power capability requirements for Synchronous, Induction, and Inverter Projects that will operate in the Non-Flow-back Mode. UPPCO's existing rate schedules, incorporated herein by reference, contain power factor adjustments based on the power factor of the metered load at these facilities.

SITE LIMITATIONS

The Project Developer is responsible for evaluating the consequences of unstable generator operation or voltage transients on the Project equipment and determining, designing, and applying any relaying which may be necessary to protect that equipment. This type of protection is typically applied on individual generators to protect the generator facilities.

UPPCO will determine if operation of the Project will create objectionable voltage flicker and/or disturbances to other Utility customers and develop any required mitigation measures at the Project Developer's expense.

REVENUE METERING REQUIREMENTS

UPPCO will own, operate, and maintain all required billing metering equipment at the Project Developer's expense.

NON-FLOW BACK PROJECTS

A Utility meter will be installed that only records energy deliveries to the Project.

FLOW BACK PROJECTS

Special billing metering will be required. The Project Developer may be required to provide, at no cost to UPPCO, a dedicated dial-up voice-grade circuit (POTS line) to allow remote access to the billing meter by UPPCO. This circuit shall be terminated within ten feet of the meter involved.

The Project Developer shall provide UPPCO access to the premises at all times to install, turn on, disconnect, inspect, test, read, repair, or remove the metering equipment. The Project Developer may, at its option, have representative witness this work.

The metering installations shall be constructed in accordance with the practices, which normally apply to the construction of metering installations for residential, commercial, or industrial customers. For Projects with multiple generators, metering of each generator may be required. When practical, multiple generators may be metered at a common point provided the metered quantity represents only the gross generator output.

UPPCO shall supply to the Project Developer all required metering equipment and the standard detailed specifications and requirements relating to the location, construction, and access of the metering installation and will provide consultation pertaining to the meter installation as required. UPPCO will endeavor to coordinate the delivery of these materials with the Project Developer's installation schedule during normal scheduled business hours.

The Project Developer may be required to provide a mounting surface for the metering equipment. The mounting surface and location must meet UPPCO's specifications and requirements.

The responsibility for installation of the equipment is shared between UPPCO and the Project Developer. The Project Developer may be required to install some of the metering equipment on its side of the PCC, including instrument transformers, cabinets, conduits, and mounting surfaces. UPPCO shall install the meters and communication links. UPPCO will endeavor to coordinate the installation of these items with the Project Developer's schedule during normal scheduled business hours.

COMMUNICATION CIRCUITS

The Project Developer is responsible for ordering and acquiring the telephone circuits required for the Project interconnection. The Project Developer will assume all installation, operating, and maintenance costs associated with the telephone circuits, including the monthly charges for the telephone lines and any rental equipment required by the local telephone provider. However, at UPPCO's discretion, UPPCO may select an alternative communication method, such as wireless communications. Regardless of the method, the Project Developer will be responsible for all costs associated with the material, installation and maintenance, whereas UPPCO will be responsible to define the specific communication requirements.

UPPCO will cooperate and provide Utility information necessary for proper installation of the telephone (or alternate) circuits upon written request.

Appendix A

Interconnection Table – Applicant Costs

	Application Review	Engineering Review	Distribution Study	Distribution Upgrades	Testing & Inspection
Category 1	\$75	\$0	\$0 (or, As Approved by Waiver)	\$0	\$0

Combined Distributed Generation / Interconnection Table – Applicant Costs

	Distributed Generation Program Fee	Application Review	Engineering Review	Distribution Study	Distribution Upgrades	Testing & Inspection
Category 1	\$50	\$75	\$0	\$0	\$0	\$0

Interconnection Timeline – Working Days

	Application Complete	Application Review	Engineering Study Completion	Distribution Study Completion	Distribution Upgrades	Testing & Inspection
Category 1	10 days	10 days	0 Days (or as allowed by Waiver)	0 Days (as allowed by Waiver)	0 Days (or as allowed by Waiver)	10 Days

Appendix B

Procedure Definitions

Alternative electric supplier (AES): As defined in section 10g of 2000 PA 141, MCL 460.10g

Applicant: Legally responsible person applying to an electric utility to interconnect a project with the electric utility's distribution system or a person applying for a Distributed Generation program. An applicant shall be a customer of an electric utility and may be a customer or an AES.

Application Review: Review by the electric utility of the completed application for interconnection to determine if an engineering review is required.

Area Network: A location on the distribution system served by multiple transformers interconnected in an electrical network circuit.

Category 1: An inverter-based project of 20kW or less that uses equipment certified by a nationally recognized testing laboratory to IEEE 1547.1 testing standards and in compliance with UL 1741 scope 1.1A.

Category 2: A project of greater than 20 kW and not more than 150 kW.

Category 3: A project of greater than 150 kW and not more than 550 kW.

Category 4: A project of greater than 550 kW and not more than 2 MW.

Category 5: A project of greater than 2 MW.

Certified equipment: A generating, control, or protective system that has been certified as meeting acceptable safety and reliability standards by a nationally recognized testing laboratory in conformance with UL 1741.

Commission: The Michigan Public Service Commission

Commissioning test: The procedure, performed in compliance with IEEE 1547.1, for documenting and verifying the performance of a project to confirm that the project operates in conformity with its design specifications.

Customer: A person who receives electric service from an electric utility's distribution system or a person who participates in a Distributed Generation program through an AES or electric utility.

Customer-generator: A person that uses a project on-site that is interconnected to an electric utility distribution system.

Distribution system: The structures, equipment, and facilities operated by an electric utility to deliver electricity to end users, not including transmission facilities that are subject to the jurisdiction of the federal energy regulatory commission.

Distribution system study: A study to determine if a distribution system upgrade is needed to accommodate the proposed project and to determine the cost of an upgrade if required.

Electric provider: Any person or entity whose rates are regulated by the commission for selling electricity to retail customers in the state.

Electric utility: Term as defined in section 2 of 1995 PA 30, MCL 460.562.

Eligible electric generator: A methane digester or renewable energy system with a generation capacity limited to the customer's electrical need and that does not exceed the following:

- 150 kW of aggregate generation at a single site for a renewable energy system
- 550 kW of aggregate generation at a single site for a methane digester

Engineering Review: A study to determine the suitability of the interconnection equipment including any safety and reliability complications arising from equipment saturation, multiple technologies, and proximity to synchronous motor loads.

Full retail rate: The power supply and distribution components of the cost of electric service. Full retail rate does not include system access charge, service charge, or other charge that is assessed on a per meter basis.

IEEE: Institute of Electrical and Electronics Engineers

IEEE 1547: IEEE "Standard for Interconnecting Distributed Resources with Electric Power Systems"

IEEE 1547.1: IEEE "Standard Conformance Test Procedures for Equipment Interconnecting Distributed Resources with Electric Power Systems"

Interconnection: The process undertaken by an electric utility to construct the electrical facilities necessary to connect a project with a distribution system so that parallel operation can occur.

Interconnection procedures: The requirements that govern project interconnection adopted by each electric utility and approved by the commission.

kW: kilowatt

kWh: kilowatt-hours

Material modification: A modification that changes the maximum electrical output of a project or changes the interconnection equipment including the following:

- Changing from certified to non-certified equipment
- Replacing a component with a component of different functionality or UL listing.

Methane digester: A renewable energy system that uses animal or agricultural waste for the production of fuel gas that can be burned for the generation of electricity or steam.

MW: megawatt

Nationally recognized testing laboratory: Any testing laboratory recognized by the accreditation program of the U.S. department of labor occupational safety and health administration.

Parallel operation: The operation, for longer than 100 milliseconds, of a project while connected to the energized distribution system.

Project: Electrical generating equipment and associated facilities that are not owned or operated by an electric utility.

Renewable energy credit (REC): A credit granted pursuant to the commission's renewable energy credit certification and tracking program in section 41 of 2008 PA 295, MCL 460.1041.

Renewable energy resource: Term as defined in section 11(i) of 2008 PA 295, MCL 460.1011(i)

Renewable energy system: Term as defined in section 11(k) of 2008 PA 295, MCL 460.1011(k).

Spot network: A location on the distribution system that uses 2 or more inter-tied transformers to supply an electrical network circuit.

UL: Underwriters Laboratory

UL 1741: The "Standard for Inverters, Converters, Controllers and Interconnection System Equipment for Use with Distributed Energy Resources."

UL 1741 scope 1.1A: Paragraph 1.1A contained in chapter 1, section 1 of UL 1741.

Uniform interconnection application form: The standard application forms, approved by the commission under R 460.615 and used for category 1, category 2, category 3, category 4, and category 5 projects.

Uniform interconnection agreement: The standard interconnection agreements approved by the commission under R 460.615 and used for category 1, category 2, category 3, category 4, and category 5 projects.


Working days: Days excluding Saturdays, Sundays, and other days when the offices of the electric utility are not open to the public.

Appendix C

Site Plan

SITE PLAN


APPLICANT	
ADDRESS	
CITY/TOWN	SIGNATURE

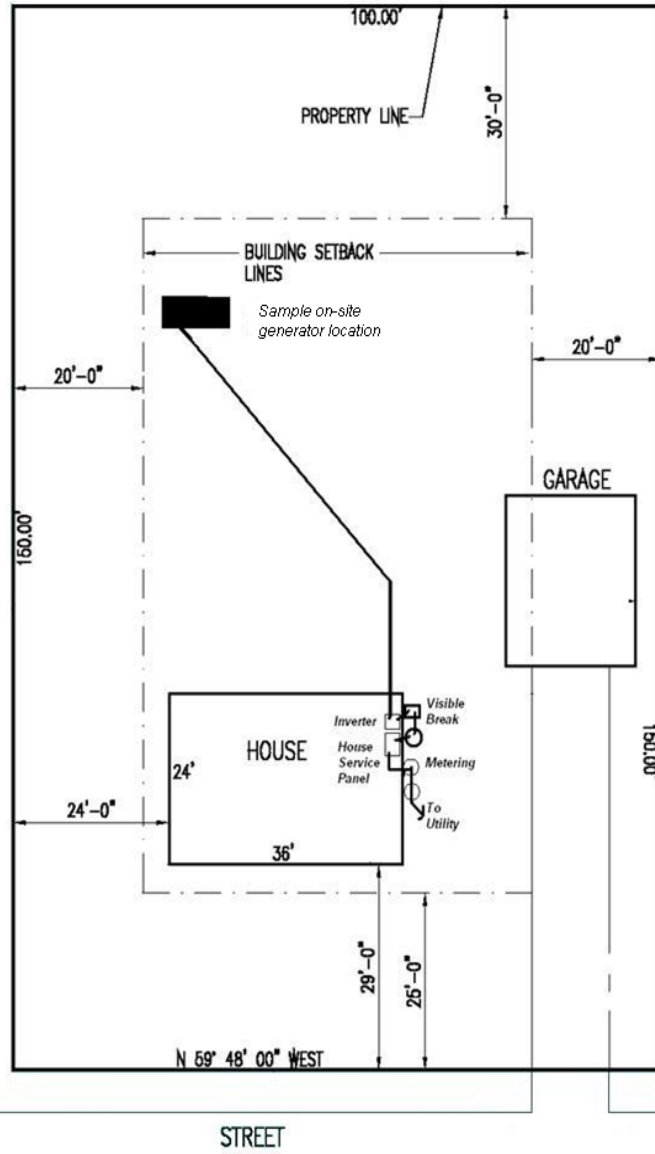

Appendix D

Sample One-Line Diagram for Inverter Projects

Sample One-Line Drawing UL 1741 Scope 1.1A Compliant

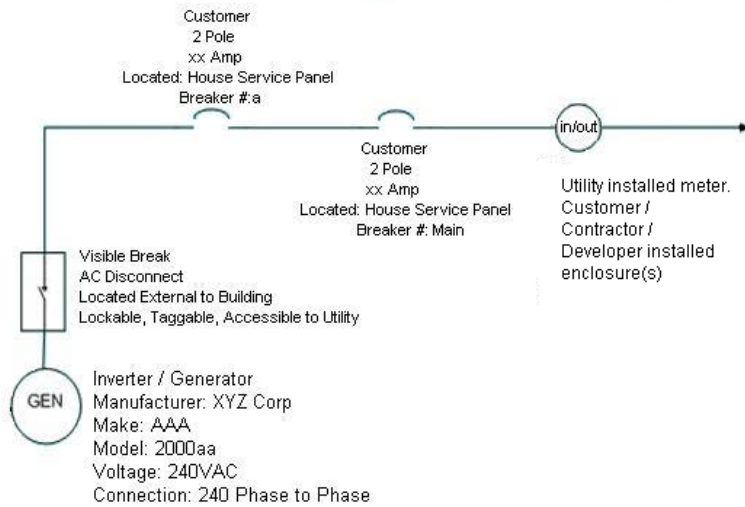

Legible Hand Drawn One-Line is acceptable

Appendix E

The Following Sample One-Line Diagrams are Available upon Request:

- 1. Sample One-Line Diagram for Synchronous Projects*
- 2. Sample One-Line Diagram for Induction Projects*
- 3. Sample One-Line Diagram for Non-Flow Back Projects*
- 4. Sample One-Line Diagram for Flow Back Projects*

For One-Line Diagrams and any other Customer-Owned Distributed Generation inquiries contact UPPCO Customer Service to speak with an Account Manager about Customer-Owned Generation.

CUSTOMER SERVICE

Phone | (906) 449-2013

Email | customergeneration@uppcoco.com